


THIRD ANGLE PROJECTION  
ALL DIMENSIONS IN mm UNLESS STATED


Scale:	Size:
Not To Scale	A3

- Notes:
1. MAXIMUM CABLE LUG SIZE FOR MAINS INPUT AND LOAD OUTPUT TERMINALS = 50mm<sup>2</sup> (M6 LUG).
  2. MAXIMUM CABLE SIZE FOR UPS INPUT AND UPS OUTPUT TERMINALS = 50mm<sup>2</sup> (M6 LUG)
  3. MAXIMUM CABLE SIZE FOR AUXILIARY CONTACTS = 4mm<sup>2</sup>.
  4. GLAND ENTRY AT REAR.
  5. PANEL COLOUR = BLACK.


TOP VIEW

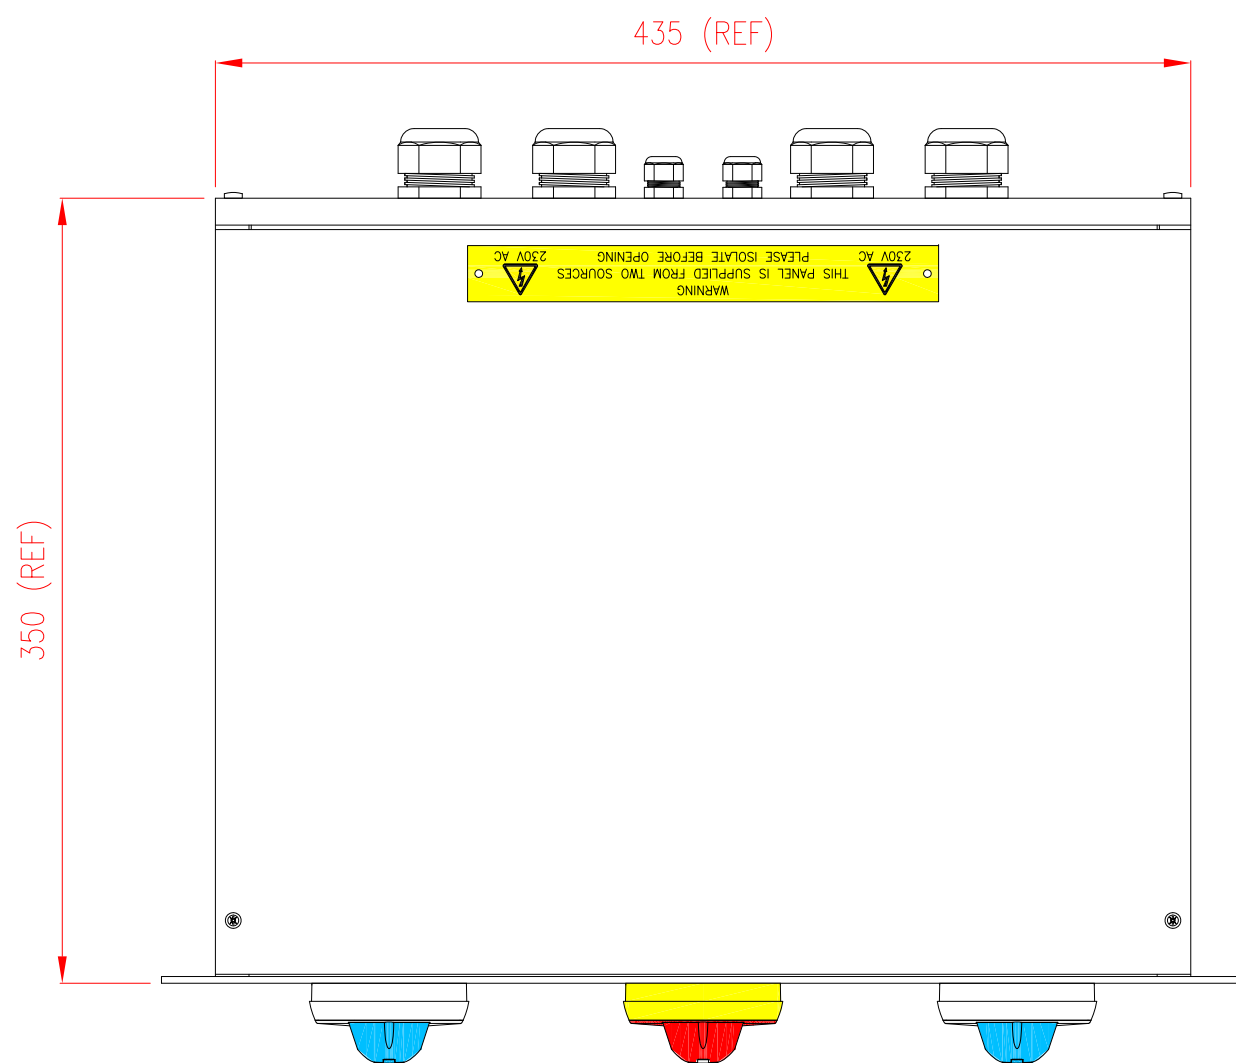

REAR VIEW

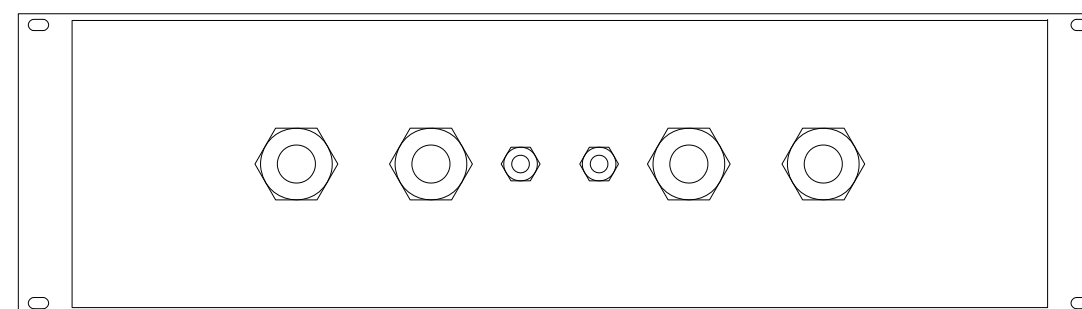

FRONT VIEW

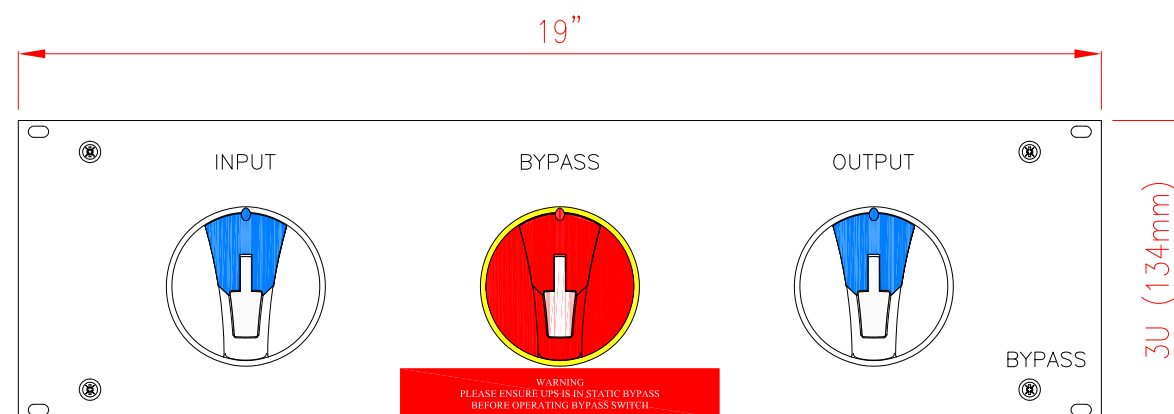

Adept Power Solutions

Unit 1, Viscount Court  
Walworth Industrial Estate, South Way  
Andover, Hampshire. SP10 5NW  
Tel: +44 (0) 1264 351217 Fax: +44 (0) 1264 351217

00	22/08/16	FIRST ISSUE	C.B
			P.J
Rev	Date	Description	Dr'n
			Ck'd

Project:  
**STANDARD PRODUCT**

Drawing Title:  
**RACK MOUNTED UPS  
EXTERNAL MAINTENANCE  
BYPASS PANEL (TYPE 2)  
SINGLE PHASE IN  
SINGLE PHASE OUT  
RATING - 32A**

Drawn By:	Date:
C.B	28/01/2019

Checked By:	Date:
P.J	28/01/2019

Drawing Number:  
**APS-BP-0327-00**